



Internal Technical Report

**A Proposal for Efficient Cooling Arrangement for
uGMRT Digital Backend**

Irappa M. Halagali

and

Mr. Ajith Kumar B.

Group Head, Digital Backend

Prof. Yashwant Gupta

Dean, GMRT

Objective : To propose a suitable cooling arrangement for the new Backend system for the uGMRT receiver, so that the system can co-exist with the GMRT Software Backend (GSB) receiver in the Central electronics building (CEB).

Index

- 1 Introduction**
- 2 Summary of experiment results**
- 3 AC distribution layout**
- 4 GWB Modelwise Power Consumption**
- 5 GWB Rackwise Power Consumption**
- 6 Measuring of air flow using meter**
- 7 Measurement of Power Consumption**
- 8 Theoretical Calculations**
- 9 Practical Measurements**
- 10 Final Conclusions**

appendices :

- I Auto calculator**
- II Experiment setup details**
- III Summary of Daily readings**
- IV Average of Daily readings**
- V Daily Readings**
- VI Air Flow meter User Manual**

1. Introduction :

A Wideband Backend (GWB) is being developed for the uGMRT based on FPGA/GPU hybrid technology. The system being developed utilises Casper designed FPGA / ADC boards to digitise the baseband signals and pass it on to server class machines with GPU cards which work as the compute nodes. The processed data is collected in host nodes through a high speed switch.

As per the current design, Dell make server T620 with two nos. of nVidia GPUs K20 will be used as the compute nodes and three nos. of T620 will be used as host nodes. Final GWB system for 32 antennae will have 5 racks of standard 19" dimension. Racks 1 to 4 will have compute node machines alongwith Roach units. Each of these racks will consume about 4,850 Watts of maximum power (Typical power consumption 2800 Watts). The fifth rack will have host machines, Switch, small units like PPS, clock and Instruments. This rack will consume about 2050 Watts maximum power (typical consumption 1,250 watts).

In order to study the heating effect of the system and finalise required cooling arrangements, theoretical calculations were done and it was later verified with experiments in the correlator room. A 42U rack has been used for the experiments, with modifications (as shown in figure) to improve the cool air flow inside the rack. Tests were also done without these modifications for comparison of the cooling effect.


2. Summary of experiment results :

A quick summary of the test results is,


a. for a power dissipation of about 4KW per rack (refer topics“4. GWB modelwise & 5. GWB rackwise Power Consumption”), the maximum outlet air temperature will be of the order of about 25 degCel., while the maximum inlet temperature is 10 degCel. More details are given in Appendix 3 : Summary of Daily Readings.

b. Volume of cool air from each duct in correlator room as per theoretical assumption is 1000cfm. It is 1600cfm as per the measurement done using air flow meter over the duct. As per the setup 3a (refer appendix II experiment setup details) , we gets a temperature difference of 9.21DegCel. This results in volume of cool air as 812cfm. The air volume using meter is around 600cfm(5' away from the duct).

Test Setup image

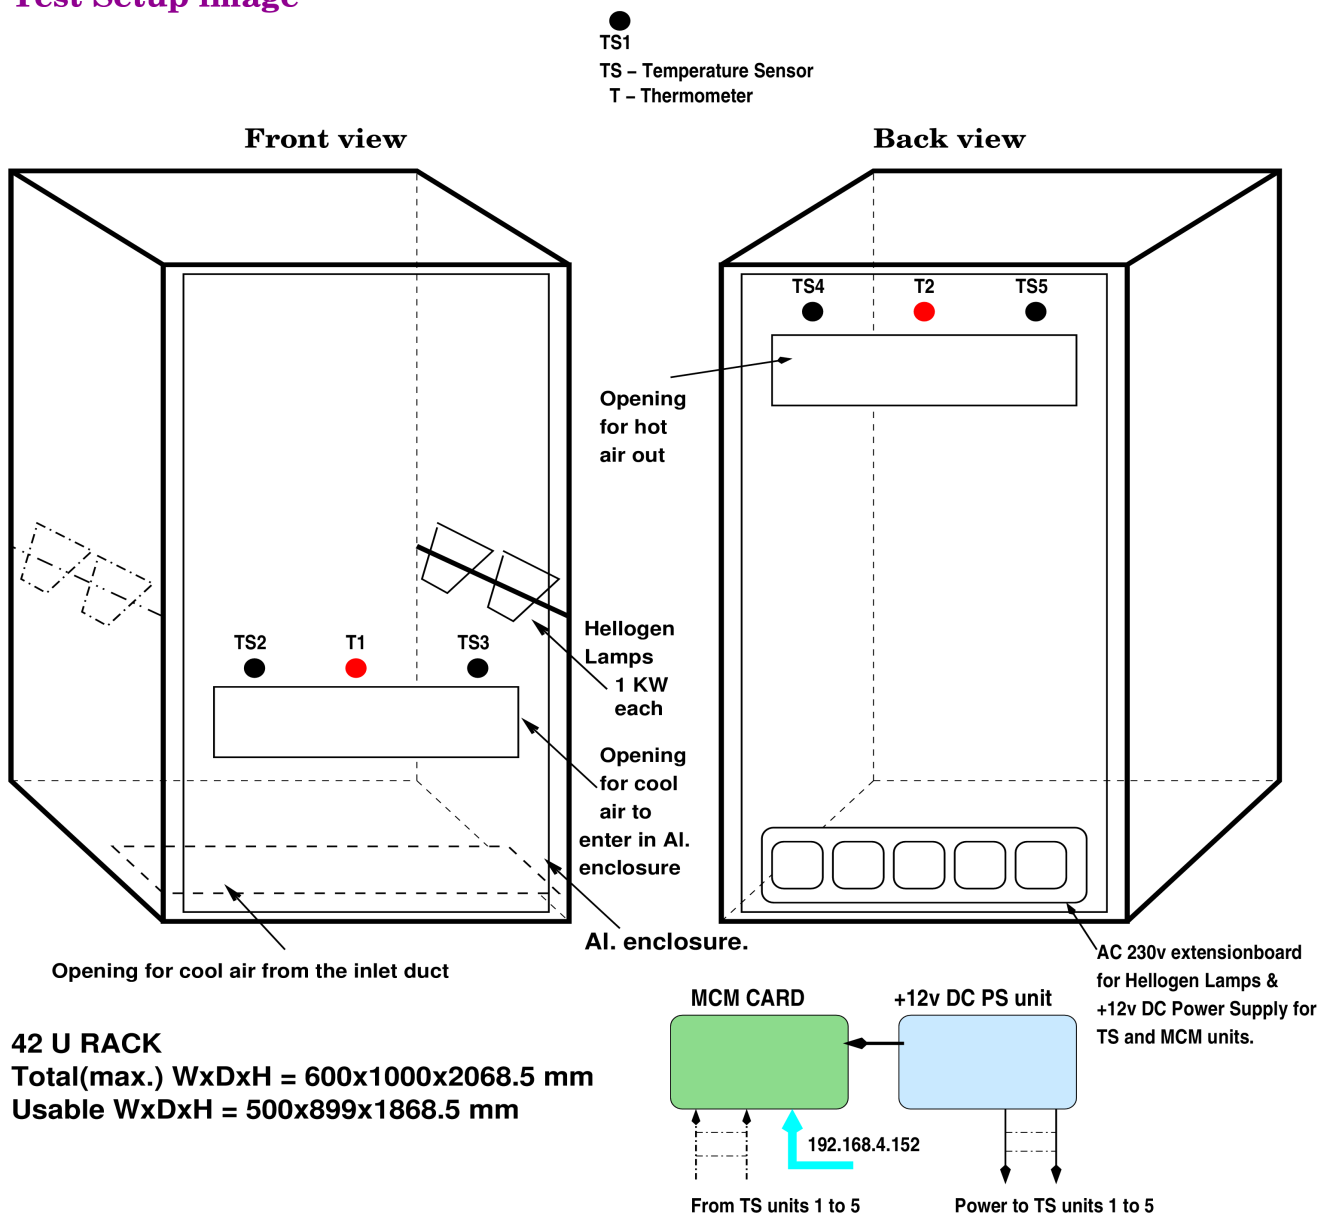

3 AC distribution layout :

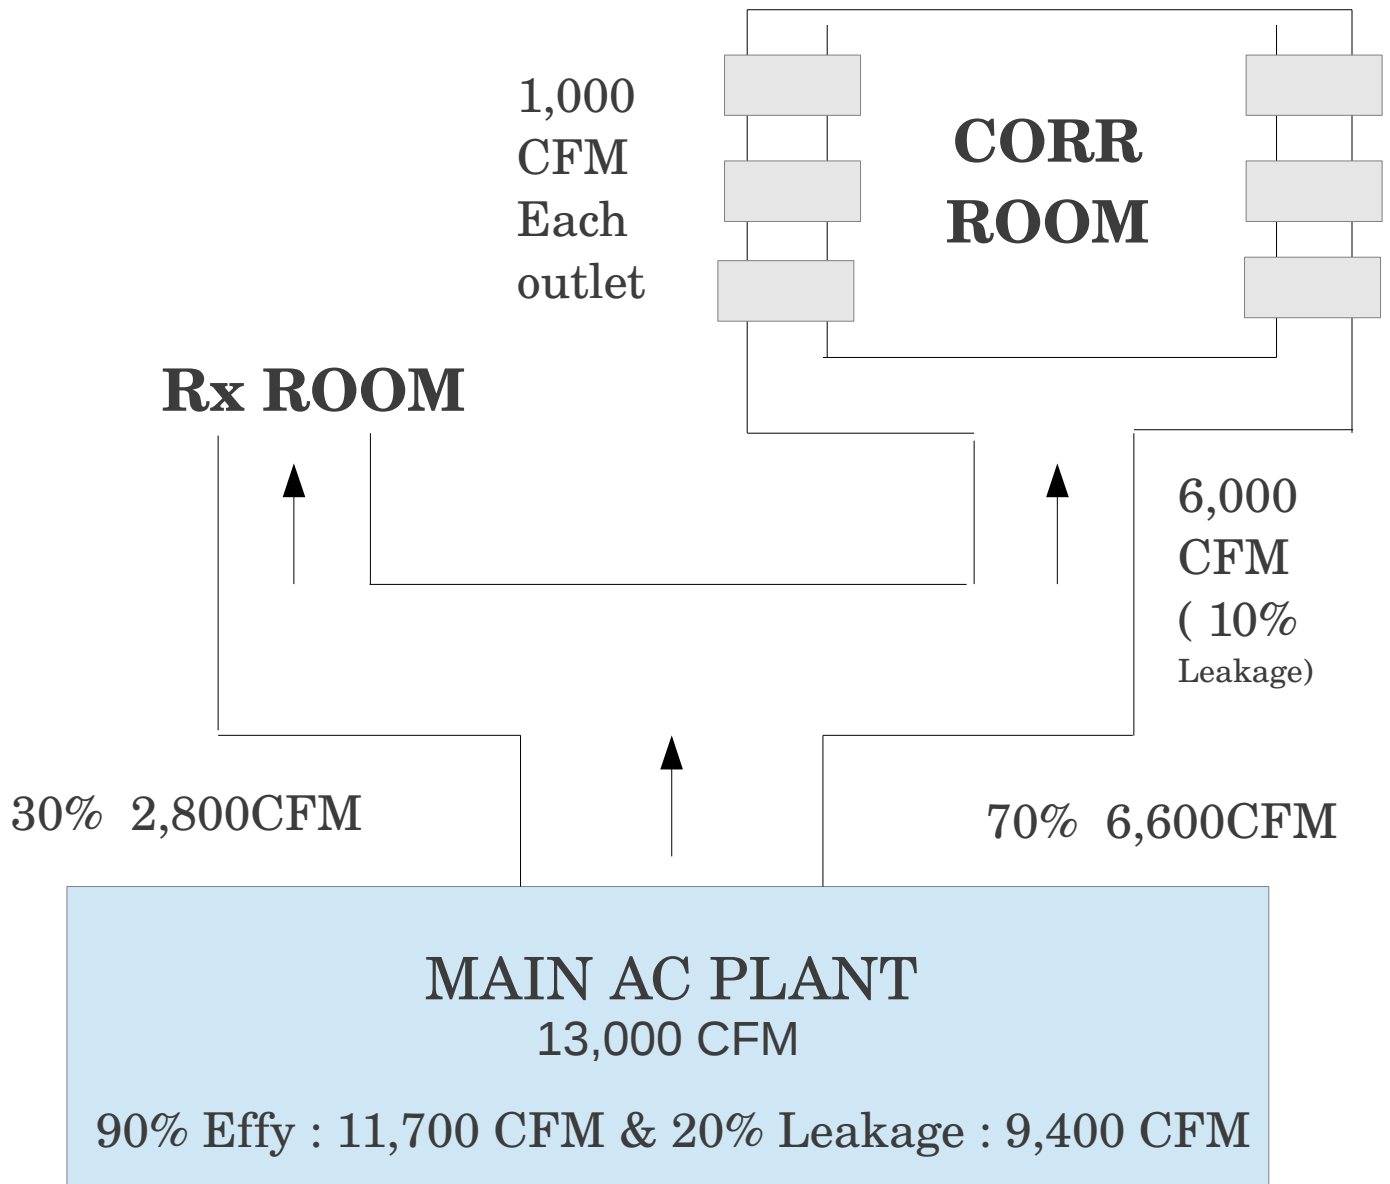

**AC Plant : Air Handling Unit (AHU) capacity
13,000 Cubic Feet per Minute (CFM).**

4 GWB Modelwise Power Consumption :

Model wise Power consumption by GWB 30 Ant. System.


Model Name	Power Consumption/Model		Total Models	Total Power Consumption	
	Typical	Maximum		Typical	Maximum
Dell T620 Nodes	369	628	16	5,904	10,048
Dell T620 Hosts	369	628	3	1,107	1,884
K20 GPU Cards	105	225	32	3,360	7,200
Myricom 10GbE Single Port	5	5	32	160	160
Melox infiniband NIC card	2	2	19	38	38
ROACH Board (1 ADC)	50	60	32	1,600	1,920
ADC in ROACH Boards	1.5	1.5	32	48	48
Melox infiniband 32P Switch	3	3	1	3	3
Signal Generator (N9310A)	65	65	1	65	65
PPS unit & misc..	50	100	1	50	100
G. Total				12,335	21,466

5 GWB Rackwise Power Consumption

Rack wise Power consumption by GWB 30 Ant. System.

Rack Number	Model Name	Power Consumption/Model		Total Models	Total Power Consumption	
		Typical	Maximum		Typical	Maximum
1 to 4	Dell T620 Nodes	369	628	4	1,476	2,512
	K20 GPU Cards	105	225	8	840	1,800
	Myricom 10GbE Single Port	5	5	8	40	40
	Melox infiniband NIC card	2	2	4	8	8
	ROACH Board (1 ADC)	50	60	8	400	480
	ADC in ROACH Boards	1.5	1.5	8	12	12
Sub Total 1					2,776	4,852
5	Dell T620 Hosts	369	628	3	1,107	1,884
	Melox infiniband NIC card	2	2	3	6	6
	Melox infiniband 32P Switch	3	3	1	3	3
	Signal Generator (N9310A)	65	65	1	65	65
	PPS unit & misc..	50	100	1	50	100
Sub Total 2					1,231	2,058
G. Total					12,335	21,466

6 Measuring of air flow using meter :

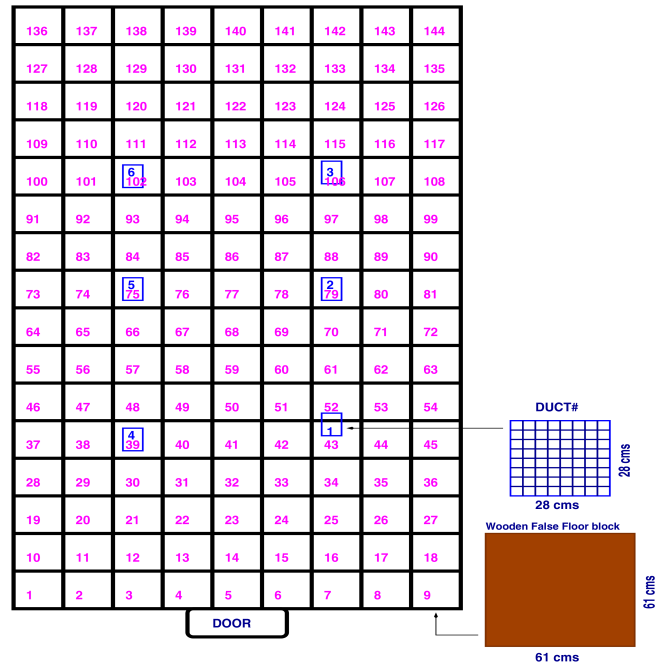

For air flow measurement in the correlator room, we have used “ Pitot Tube Anemometer + Differential Manometer HD350” from Extech Instruments. Measured the air flow volume over the duct number 1 and 3. Using this meter, we measured air flow at 5 points in the duct (4 corners and at the centre about half a foot height) and took average of those readings. It was around 1600cfm & 1200cfm from duct number 1 & 3 respectively.

Detailed measurement of air flow from AC plant to end points in Correlator & Receiver rooms needs to be done at various possible locations. This will give the complete and exact know how about the cool air volume at different locations and leakages.

The air flow measurement procedure is explained in appendix “VI Air Flow Meter User Manual”

7 Measurement of Power Consumption :

Two months back measured the power consumption by the GWB host PC with cards, while correlator code running. The Power consumption was near to Typical Values as per the datasheets/documents. But we need to check again with all the peripherals in the node PC and final code running on it. This may force the power consumption towards maximum ratings.

Setup image and details to be added for future references.

8 Theoretical Calculations :

For this theoretical calculations, we have considered the following as inputs :

1. Maximum heat energy from GWB system is 21,500 watts.
2. Cool air entering the correlator room is 6000 CFM (Cubic Feet per Minute).
3. Difference in temperature of air in the corr room = 15 DegCel from inlet to outlet.
4. Constants :
 - a. 1 Joule = 0.238902957619 calories.
 - b. $1 \text{ ft}^3 = 0.02832 \text{ mtr}^3$
 - c. average Air density is $1.128666667 \text{ kg/mtr}^3$ for average temperature of 17.5 DegCel.
 - d. Specific Heat of air @ 20 DegCel & 1 pascal is 240 calories/kg degree celsius.

A. Maximum Total Heat Energy in calories/min. from the GWB system.

$$\begin{aligned} \text{Total Heat Energy in Joules/min.} &= \text{Total Power consumption} * 1 \text{ minute} \\ &= 21,500 \text{ watts} * 60 \text{ sec.} = 12,90,000 \text{ Joules/min.} \end{aligned}$$

$$1 \text{ Joule} = 0.238902957619 \text{ calories} , 1 \text{ calorie} = 4.186 \text{ joules} .$$

$$\text{Total Heat Energy in calories/min.} = 12,90,000 * 0.238902957619 = 3,08,185 \text{ calories/min.}$$

B. Heat Absorption of the cool air in calories/min. from the AHU(AC Plant).

$$\begin{array}{l} \text{Heat Absorption} = \text{mass} \quad * \quad \text{Specific Heat of air} \quad * \quad \text{Diff. in temp.} \\ \text{of the cool air} \quad \text{kg/min.} \quad \quad \text{Calories/kg} \quad \quad \text{degree cel.} \\ \quad \quad \quad \quad \quad \quad \quad \quad \quad \quad \quad \quad \quad \quad \quad \text{degree celsius} \end{array}$$

a. "mass"

$$\text{mass} = \text{Air Density kg/mtr}^3 * \text{Volume mtr}^3/\text{min.} = \text{kg/min.}$$

i. Air Density in kg/mtr^3 :

<http://www.weatheronline.in/weather/maps/city> & <http://www.denysschen.com/catalogue/density.aspx>

Air Density @ Pune (above sea level of 1837 feet or 560 mtrs and relative humidity varies between 24 to 94 % in the year 2014) for average relative humidity of 59%) is

Temperature in DegCel	Air Density in kg/mtr^3 @ pressure of 1 pascal
10	1.16
17	1.13
25	1.096

So average Air density is $1.128666667 \text{ kg/mtr}^3$ for average temperature of 17.5 DegCel.

ii. Air Volume in mtr^3/min :

$$1 \text{ ft}^3 = 0.02832 \text{ mtr}^3 \quad \& \quad 1 \text{ mtr}^3 = 35.31467 \text{ ft}^3$$

$$\text{So volume of cool air reaching corr. Room} = 6,000 \text{ ft}^3/\text{min.} = 169.92 \text{ mtr}^3/\text{min.}$$

So mass of cool air reaching corr. Room = $1.128666667 * 169.92$
 $\text{kg/mtr}^3 \quad \text{mtr}^3/\text{min.}$

$$= 191.783040057 \text{ kg/min.}$$

b. "Specific Heat of air = 240 calories/kg degree celsius.
@ temp. of 20degree cel. &
pressure of 1 pascal

www.usc.edu/org/.../Heat%20Capacity%20and%20Specific%20Heat.pdf , http://www.engineeringtoolbox.com/specific-heat-capacity-d_391.html

c. "Diff. in temperature = $25 - 10 = 15$ degree celsius
of corr. Room

So,

$$\begin{aligned} \text{Heat Absorption of the cool air} &= 191.783040057 * 240 * 15 \\ &\text{kg/min.} \quad \text{Calories/kg} \quad \text{DegCel.} \\ &\text{per DegCel.} \\ &= 6,90,419 \text{ calories/min.} \end{aligned}$$

So,

$$\begin{aligned} \text{Heat Absorption of the cool air from each outlet} &= 6,90,419 / 6 \\ \text{in the correlator room} &= 1,15,070 \quad \text{Calories/min.} \end{aligned}$$

Conclusion :

a. Heat absorption of cool air from each inlet of 1000 CFM and inlet to outlet temperature difference of 15 DegCel is 1,15,070 Calories/minute.

b. So to absorb 3,08,185 calories/min. of heat generated by GWB system, we need 2.68 ($308185 \div 115070$) cool air inlets. Each inlet of 1000 CFM cool air.

9 Practical measurements :

For this practical measurements, we have used the Heat load of 4000 Watts. Maximum GWB power consumption is 21,500 watts or 3,08,185 calories/minute (refer "5. GWB rackwise power consumption").

Conclusion :

A. Using 3 fans of 100cfm each to suck the cool air in the aluminium cage in the rack.

We got the temperature difference of 15.5 degreeCel. So

Volume of cool air per inlet in the correlator room is 482 Cubic Feet/Minute instead of 1000CFM !!!

Total Heat Energy --> 3,08,185 calories/minute
Heat Absorption by 482cfm Cool Air --> 57,312 calories/minute
So 5.38 inlets with cool air of 482 CFM are required !!!

B. Using 2 fans of 600cfm each to suck the cool air in the aluminium cage in the rack.

If these fans are at 2' height of the al. cage, then the temperature difference is 5.4 degCel.

If moved these fans at the bottom of the rack and kept this 2' height slot in the al. cage open, then the temperature difference is 9.21degCel. This temperature increases by around 1 degCel, if we put 3 fans of 100cfm each at the open slot in the al. cage!

If we take 5.4 degCel., then

- a. Volume of cool air per inlet in the correlator room is 1384 CFM.
- b. Heat Absorption by 1384 CFM Cool Air is 1,64,565 calories/minute.
- c. So 1.87 inlets with cool air of 1384 CFM are required.

If we take 9.21 degCel., then

- a. Volume of cool air per inlet in the correlator room is 812 CFM.
- b. Heat Absorption by 812 CFM Cool Air is 96,551 calories/minute.
- c. So 3.19 inlets with cool air of 812 CFM are required.

10 Final Conclusions :

A. Theoratically each inlet gives 1000CFM of cool air. So we need 2.68 cool air inlets. But practically, with 3fans of 100cfm each to suck the cool air into the al. cage, we need 5.38 cool air inlets. This is double the theoratical requirement. So we have to find out the reasons, which could be as follows ;

1. Actual cool air spilt for the correlator room may not be 6000 CFM.
2. There may be leakage between the AHU and correlator room inlets.
3. May be considerable leakages at the bottom of the rack.
4. May be adjustment of locations of the heat load is required in the rack, in order to utilize the cool air efficiently.
5. May be adjustment of locations of the input/output thermometers is required to findout the actual volume of the cool air, which may be more than 482 CFM.
6. If possible and not harmful to the system, increase the humidity of the cool air (decrease the temperature of the cool air comming out of the inlets).

B. We found the following things are useful in utilising the cool air efficiently.

1. We have replaced the 3 fans of 100cfm each to suck the cool air into the al. cage by 2 fans of 600cfm at 2' height in the al. cage.
2. Made sure the cool air entered in the rack, shouldn't leakout.
3. And also took care of no obstacles in the cool air flow towards the exit in the rack.

Enentough the rack is kept 5 feet away from the cool air duct and without any aluminium cage/duct to bring the cool air from the inlet(setup No. 3a), we got a averaged temperature difference of 5.4 degCel.

If we move these fans from the al. cage to the bottom of the rack and keep the slot in the al. cage @ 2' height open, then the temperature difference increases to 9.21 degCel.

This temperature increases by around 1 degCel, if we put 3 fans of 100cfm each at the open slot in the al. cage!

If we take maximum of these ie 9.21 DegCel, then the volume of cool air from the outlet is 812cfm.

So we need 3.19 inlets of 1000cfm cool air to dissipate 21,500KW heat from GWB system.

Appendices will follow in the next page

Appendices :

I Auto calculator :

please use the file auto_calc_temp.ods to change the input parameters to get output values.

Sample file attached here for standard input parameters...

User Parameters :	INPUTS	Output Parameters	OUTPUTS
PowerConsumption in Watts -->	21500	Total Heat Energy in calories/minute -->	3,08,185
Difference in Temperature -->	15	Heat Absorption of Cool Air cal/min -->	1,15,070
Volume of Cool Air in ft ³ -->	1000	Number of cool air inlets required..	2.68
Heat absorption in watts -->	4,000		
Difference in temperature deg. Cel. -->	15.50	Volume of Cool Air in ft ³ :	482

Constant Parameters :	Constant Values	Intermittent Calculation Parameters :	int'nt. results
1 Joule equal to --> Calories	0.2389029576	Volume of Cool Air in mtr ³ -->	28.32
1 Cubic feet equal to --> Cubic mtr	0.02832	Mass of cool air in kg/minute -->	31.963840009
Air Density kg/mtr ³ @ 25dC & 1 Pascal	1.128666667		
Specific Heat of Air cal/kgdC @ 20dC & 1 Pascal	240		

Tables :

Total Heat Energy in Cal./min.

For 1000 watts of Power Consumption -->	14,334
For 1500 watts of Power Consumption -->	21,501
For 2000 watts of Power Consumption -->	28,668
For 2500 watts of Power Consumption -->	35,835
For 3000 watts of Power Consumption -->	43,003
For 3500 watts of Power Consumption -->	50,170
For 4000 watts of Power Consumption -->	57,337
For 4500 watts of Power Consumption -->	64,504
For 5000 watts of Power Consumption -->	71,671

Volume of Cool Air in ft³ @1KW heat if :

Temperature difference of 3 deg. Cel.	2,491
Temperature difference of 3.5 deg. Cel.	2,135
Temperature difference of 4 deg. Cel.	1,869
Temperature difference of 4.5 deg. Cel.	1,661
Temperature difference of 5 deg. Cel.	1,495

Heat Absorption of Cool Air in cal./min. For 1000ft³/min. Cool air

For Temperature difference of 1 deg.Cel.	7,671
For Temperature difference of 1.5 deg.Cel.	11,507
For Temperature difference of 2 deg.Cel.	15,343
For Temperature difference of 2.5 deg.Cel.	19,178
For Temperature difference of 3 deg.Cel.	23,014
For Temperature difference of 3.5 deg.Cel.	26,850
For Temperature difference of 4 deg.Cel.	30,685
For Temperature difference of 4.5 deg.Cel.	34,521
For Temperature difference of 5 deg.Cel.	38,357
For Temperature difference of 5.5 deg.Cel.	42,192
For Temperature difference of 6 deg.Cel.	46,028
For Temperature difference of 6.5 deg.Cel.	49,864
For Temperature difference of 7 deg.Cel.	53,699
For Temperature difference of 7.5 deg.Cel.	57,535
For Temperature difference of 8 deg.Cel.	61,371
For Temperature difference of 8.5 deg.Cel.	65,206
For Temperature difference of 9 deg.Cel.	69,042
For Temperature difference of 9.5 deg.Cel.	72,878
For Temperature difference of 10 deg.Cel.	76,713

II Experiment setup details :

The following setups were done with the help of mechanical and electrical sections. These setups were used to study the effects of cooling over varying temperature under different conditions like when the rack is placed over the inlet cool air duct or 5 feet away from it and so on.... A total of 8 setups were created to study the possible conditions to make out the rise in temperature at the output over input ie difference in temperature of the air entering the rack and exiting the rack.

Setup 1 : 42U Rack directly on the cool air inlet in the corr room with all the leakages at the bottom closed. The cool air enters the rack from the front bottom opening and enters the aluminium cage through a window provided in the cage at a height of about 2 feet. One thermometer(T1) and two temperature sensors (S2 & S3) are present at this opening to measure the inlet temperature. Inside the al. cage about a feet high 4 hellogen (with seperate ON-OFF switches in the two extension boards having current carrying capacity of 16amps. These two extension boards are getting power from MSEB metal MCB box through 25amps MCB) lamps of 1 KW each are mounted. Some 3 feet above these lamps there is window in the al cage at the backside for heated air to exhaust. At this poist also one thermometer (T2) and two sensors (S4 & S5) are mounted. Sensor S1 is outside and near to this rack.

Rabbit card gets input on pin numbers 1 to 5 on 64pin FRC male connector from sensors S1 to S5 respectively. +11 volts power has been given to this rabbit card as well all to all temperature sensor cards. An ethernet cable with ip 192.168.4.152 has been connected to this rabbit card for web based monitoring of temperature.

Setup 2 : setup 1 with 3 fans of 100cfm each, mounted at the height of about 2 feet front side, to suck air in the aluminium cage.

Setup 2a : setup 2 with 2 fans of 600cfm each, mounted at the height of about 2 feet front side, to suck air in the aluminium cage. This is done with and without aluminium plate in al. cage to abstruct the air.

Setup 3 : setup 1 & 2 with whole setup moved about 5 feet away from cool air inlet duct. Cool air brought to the rack's inlet using aluminium sheet enclosure underneath the false flooring.

Setup 3a : setup 3 with 2 fans of 600cfm each instead 3 fans with 100cfm each and without al. enclosure to bring the cool air to rack.This is done with and without an aluminium plate in the al. cage in the rack, to be an obstacle in the air flow.

Setup 3b : setup 3a with 2 fans of 600cfm each, moved to bottom of the rack with opening @ 2' height. This is done with and without an aluminium plate in the al. cage in the rack, to be an obstacle in the air flow.

Setup 4 : setup 3 without fans to suck the cool air in the aluminium cage at 2 feet height.

Setup 5 : setup 3 without aluminium sheet enclosure underneath the false flooring to bring the cool air from the inlet duct to the rack and with fans to suck the air in the aluminium cage at 2 feet height.

Setup 6 : setup 5 but without fans to suck the cool air in the aluminium cage at 2 feet height.

Setup 7 : Rack without any modifications (aluminium cage in the rack removed). Kept 5 feet away from the cool air inlet duct. Input temperature monitoring about 2 feet high at the frontside. Four

hellogens of 1 KW each mounted at the centre of the rack. And output temperature monitoring at the top of the rack's rear side.

Setup 8 : Rack without any modifications (aluminium cage in the rack removed). Kept over the cool air inlet duct. Input temperature monitoring about 2 feet high at the frontside, where cool air blows in the rack's bottom. Four hellogens of 1 KW each mounted at the centre of the rack. And output temperature monitoring at the top of the rack's rear side.

T – Thermometer readings average. & S – Temperature Sensors readings average in Deg. Cel.
LH – Left Hand side RH – Right Hand side (from back) F- Front of rack B – Back of rack.

III Summary of Daily readings :

Setup No.	Measuring Instrument	Average temp. readings for				Max. output temp. for 4KW	Temp. Sensor minus Thermometer readings.
		1KW	2KW	3KW	4KW		
I	Themometer	3.0	6.6	11.2	--	20.0	1.2
	Temperature Sensor	4.2	8.2	12.2	--		
II	Themometer	2.6	6.3	9.0	11.7	22.5	2.2
	Temperature Sensor	4.3	8.2	11.7	14.2		
IIa	Themometer/TempSe	6.23	8.89	with al. plate		16.00	2.26
	Themometer/TempSe	3.50	6.06	w/o al. plate		17.00	2.56
III	Themometer	2.8	7.3	12.5	14.8	25.5	2.6
	Temperature Sensor	5.3	10.0	14.9	17.6		
IIIa	Themometer/TempSe	9.21	9.23	with al. plate		20.00	0.02
	Themometer/TempSe	6.12	5.33	w/o al. plate		21.00	-0.79
IIIb	Themometer/TempSe	10.64	13.26	with al. plate		20.50	2.62
	Themometer/TempSe	10.82	12.84	w/o al. plate		20.00	2.02
IV	Themometer	3.5	10.0	14.1	18.5	28	2.8
	Temperature Sensor	6.4	12.6	17.1	21.4		
V	Themometer	4.8	9.5	11	18.4	33	-3.0
	Temperature Sensor	3.8	6.5	9.3	12.1		
VI	Themometer	8.0	18.2	24.8	31.7	46	1.8
	Temperature Sensor	10.5	20.0	26.8	32.7		
VII	Themometer	-5.2	-3.2	-1.3	-1.1	31.5	1.9
	Temperature Sensor	-0.8	-1.3	-2.3	+1.2		
VIII	Themometer	-2.2	-3.1	-3.1	-2.8	9.0	1.0
	Temperature Sensor	-0.5	-1.4	-2.0	-3.3		

Note : Thermometer readings are considered.

My words on this summary :

1. Since maximum temperature crosses 26 degCel (16 degCel over the temperature at the duct) for the setups IV and above, not considered for further evaluation.
2. The cool air entering the rack must be sucked towards the loads and heat air must be sucked out.
3. Temperature goes down by about 0.5 to 2 degCel for 1KW to 4KW load, if we use fans to suck the air when the rack is over the duct. But this trend reverses when the rack is 5 feet away from the duct with fans.
4. Temperature for 1KW about 3 degCel. It increases by about 3.5 degCel from 1KW to 2KW. And by 3 to 5 degCel & about 2.5 degCel for 2 to 3KW and 3 to 4KW respectively.
5. Setup 2a, 3a & 3b done after all other setups, to make use of the cool air efficiently. We got succeeded in using it almost 100% efficiently by using 2 fans of 600cfm each to suck the cool air into the rack. Set up 3a & 3b with some modifications may be used for final setup.

IV Average of Daily readings :

SETUP : 1

42U Rack directly placed on the cool air inlet in the correlator room with all the leakages at the bottom closed. Aluminium cage with cool air in and hot air out and load in the centre of the cage.

Date	Difference in Temperature Readings		Heat load of KW's	Time	Remarks
	T	S			
10/10/2014	4	4	1	12 - 17	Readings every half an hour
11/10/2014	7	8.5	2	11 - 17	"
13/10/2014	3	4	1	10 - 17	"
14/10/2014	8	8.5	2	10 - 17	"
15/10/2014	3.5	4	1	10 - 17	"
16/10/2014	2.5	4.5	1	10 - 17	"
18/10/2014	3	4.2	1	10 - 17	"
20/10/2014	2	4	1	10 - 15	"
21/10/2014	3	4.5	1	10 - 12	LH-1 every 5 min.
	10.5	11.5	3	12 - 13	LH-1 + RH-2 "
22/10/2014	6	8	2	10 - 12	LHB + RHB every 10 min.
	5.5	8	2	12 - 13	LHF + RHF "
	12	13	3	14 - 15	LH-2 + RH "

Average Readings in degCel.

	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>
Themometer	3	6.6	11.2	18
Temp. Sensors	4.2	8.2	12.2	21

Conclusions : Temperature Sensor results are about 1.2degCel. more than the Themometer readings. And maximum output temperature for 4 KW is about 20 degCel.

SETUP : 2

setup 1 with 3 fans of 100cfm mounted at the height of about 2 feet front side, to suck air in the aluminium cage.

Date	Difference in Temperature Readings		Heat load of KW's	Time		Remarks
	T	S				
28/10/2014	2	4.2	1	10:00 - 11:40	LHB	every 10 min.
	8.5	9	2	11:45 - 13:00	LHB + RHB	“
	10	12.5	3	14:10 - 15:30	LH-2 + RH	“
	13	15.5	4	15:40 - 16:40	All	“
29/10/2014	11	13.5	4	09:40 - 11:30	All	every 10 min.
	10	12.5	3	11:40 - 13:00	LH-2 + RHF	“
	7.5	9.5	2	14:20 - 15:20	LHB + RHB	“
	2.5	4.5	1	15:55 - 17:10	LHB	“
30/10/2014	2	4.2	1	09:45 - 10:40	LHF	every 10 min.
	2	4	1	10:50 - 11:45	RHF	“
	4	5.2	1	12:00 - 12:55	RHB	“
	2.5	4	1	14:10 - 15:00	LHB	“
	5	7	2	15:30 - 16:10	LH-2	“
	5.5	8	2	16:20 - 17:20	RH-2	“
31/10/2014	6.2	7.7	2	09:50 - 11:30	LHF+RHB	every 10 min.
	5.2	7.7	2	11:35 - 14:20	LHB+RHF	“
	7.2	10.3	3	14:25 - 16:40	LH-2+RHF	“
31/10/2014	11	13.5	4	09:45 - 16:00	All	every 10 min.
26/05/2015	8.0	10.5	4	14:30 - 16:50	All	every 10 min.

Page 19

Average Readings in degCel.

	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>
Themometer	2.6	6.3	9.0	11.7
Temp. Sensors	4.3	8.2	11.7	14.2

Conclusions : Temperature Sensor results are about 2 degCel. more than the Themometer readings. And maximum output temperature for 4 KW is about 22.5 (1/11/2014@14:50hrs) Alos noted a decrease of temperature by 3 degCel if remove the al. plate in the al. cage.

SETUP : 2a

setup 2 with 2 fans of 600cfm mounted at the height of about 2 feet front side, to suck air in the aluminium cage.

Date	Difference in Temperature Readings		Heat load of KW's	Time	Remarks
	T	S			
	03/06/2015 Page 20	6.23			
05/06/2015 Page 20	3.50	6.06	4	10:20 - 17:00 All	every 10 min. w/o al. plate obstacle in the al. cage.

SETUP : 3

setup 1 & 2 with whole setup moved about 5 feet away from cool air inlet duct. Cool air brought to the rack's inlet using aluminium sheet enclosure underneath the false flooring.

Date	Difference in Temperature Readings		Heat load of KW's	Time	Remarks
	T	S			
	07/11/2014 Sheet 1	6.8			
10/11/2014 sheet 2	16.0	17.82	4	10:00 - 13:00 All	“
11/11/2014 sheet 3	12.72	15.25	3	14:15 - 17:10 LH-2+RHB	“
12/11/2014 sheet 4	2.28	5.12	1	10:00 - 14:20 LHF	“
13/11/2014 sheet 5	6.50	8.74	2	14:50 - 17:15 RH-2	“
14/11/2014 sheet 6	6.19	9.36	2	10:00 - 14:20 LH -2	“
15/11/2014 sheet 7	7.00	10.08	2	14:10 - 15:15 LHB+RHF	“
16/11/2014 sheet 8	7.50	10.54	2	09:50 - 14:35 LHF+RHB	“
	1.93	4.04	1	14:40 - 17:10 RHF	“
	3.93	6.13	1	10:20 - 14:40 RHF	“
	2.81	5.53	1	14:45 - 17:20 LHB	“
	3.30	5.95	1	10:10 - 11:30 RHB	“
	9.64	12.02	2	11:35 - 14:20 LHB+RHB	“
	12.33	14.63	3	14:30 - 15:50 LHB+RH-2	“
	13.70	16.38	4	15:55 - 17:20 All	“
	14.79	18.67	4	09:25 - 20:10 All	“

Average Readings in degCel.

	1KW	2KW	3KW	4KW
Thermometer	2.8	7.3	12.5	14.8
Temp. Sensors	5.3	10.0	14.9	17.6

Conclusions : Temperature Sensor results are about 2.5 degCel. more than the Thermometer readings. And maximum output temperature for 4 KW is about 25.5 ([16/11/2014@12:00hrs sheet no. 8 of temp_readings.ods file.](#))

Setup 3a : setup 3 with 2 fans of 600cfm each instead 3 fans with 100cfm each.

Date	Difference in Temperature Readings		Heat load of KW's	Time	Remarks
	T	S			
08/06/2015 Page 21	6.12	5.33	4 All	15:10 - 17:10	every 10 min. w/o al. plate obstacke in the al. cage.
09/06/2015 Page 21	9.21	9.23	4 All	10:00 - 17:10	every 10 min. with al. plate obstacke in the al. cage.
16/06/2015 page 22	9.89	12.74	4 All	14:40 – 17:10	with plate “

Setup 3b : setup 3a with 2 fans of 600cfm each moved to bottom of the rack with opening @ 2' height.

17/06/2015 Page 22	10.64	13.26	4 All	10:10 - 17:10	every 10 min. with al. plate obstacke in the al. cage.
18/06/2015 Page 23	10.82	12.84	4 All	10:00 - 17:10	every 10 min. w/o al. plate obstacke in the al. cage.

SETUP : 4

setup 3 but without fans to suck the cool air in the aluminium cage at 2 feet height.

{Sheet number 13 & 14 in the temp_readings.ods file}

Date	Difference in Temperature Readings		Heat load of KW's	Time	Remarks
	T	S			
26/12/2014 Sheet 13	18.00	21.30	4	11:50 - 15:30 All	every 10 min.
	14.80	17.69	3	15:40 – 17:10 LH-2+RHF	“
27/12/2014 Sheet 13	11.54	13.33	2	09:55 - 12:00 LHB+RHB	every 10 min.
	04.53	06.61	1	12:10 – 16:10 LHB	“
	18.33	21.15	4	16:20 - 21:00 All	
28/12/2014 Sheet 14	13.44	16.48	3	12:20 – 15:00 LHF+RH-2	every 10 min.
	08.57	11.99	2	15:10 - 16:30 LHF+RHF	“
	02.50	06.15	1	16:40 – 20:30 RHF	“
29/12/2014 Sheet 14	19.21	21.70	4	10.10 - 16:40 All	every 10 min.

Note : In this setup when bottom of the rack wasn't packed properly, so cool air was passing there. The average readings were about 1 to 4 degrees higher than the above mentioned (Readings in the Sheet number 9 of temp_readings.ods file) readings for 1KW to 4KW load resp.. Above readings are taken again after packing the rack bottom with the floor.

Average Readings in degCel.

	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>
Themometer	3.5	10.0	14.1	18.5
Temp. Sensors	6.4	12.6	17.1	21.4

Conclusions : Temperature Sensor results are about 1.2degCel. more than the Themometer readings. And maximum output temperature for 4 KW is about 28.0 (26,27,29/11/2014 sheets 13 & 14)

SETUP : 5

setup moved 5 feet away from the inlet cool air duct, without aluminium duct between cool air inlet and rack but fans to suck air at the aluminium cage present.

{Sheet number 11 in the temp_readings.ods file}

Date	Difference in Temperature Readings		Heat load of KW's	Time		Remarks
	<u>T</u>	<u>S</u>				
26/11/2014	11.90	08.23	3	09:50 - 11:30	LHF+RH-2	every 10 min.
Sheet 11	09.60	06.86	2	12:00 - 13:00	LHF+RHF	“
27/11/2014	17.95	11.33	4	11:30 - 13:00	All	every 10 min.
Sheet 11	06.45	05.35	1	14:20 - 16:00	LHB	“
	09.20	06.14	2	16:30 - 17:10	LHB+RHF	“
28/11/2014	18.31	11.37	4	10:20 - 12:50	All	every 10 min.
Sheet 11						
31/12/2014	18.73	12.17	4	10:30 - 16:30	All	“
sheet 16						
01/01/2015	10.14	10.44	3	10:00 - 11:30	LH-2+RHB	“
sheet 16	9.63	06.44	2	14.15 - 16:00	LHF+RHB	“
02/01/2015	3.22	02.18	1	10:10 - 14:10	RHF	“
sheet 16	17.79	12.38	4	15:00 - 16:00	All	“
03/01/2015	19.14	13.14	4	10:00 - 12:10	All	“

Note : In this setup Thermometer reading are higher than the sensor readings!

	Average Readings in degCel.				Max. o/p temp. 4KW	Themometer +/- Temp. Sensor
	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>		
Themometer	4.8	9.5	11	18.4		
Temp. Sensors	3.8	6.5	9.3	12.1		

Conclusions : Temperature Sensor results are about 1 to 6 degCel. less than the Themometer readings. And maximum output temperature for 4 KW is about 33degCel (sheets 11 and 16)

SETUP : 6

setup 5 but without fans to suck the cool air in the aluminium cage at 2 feet height.
{Sheet number 12 in the temp_readings.ods file}

Date	Difference in Temperature Readings		Heat load of KW's	Time		Remarks
	T	S				
28/11/2014	08.00	10.55	1	14:30 - 16:00	LHF	every 10 min.
Sheet 12	18.70	20.61	2	16:20 - 17:00	LHF+RHB	“
01/12/2014	23.85	26.10	3	10:00 - 12:00	LHF+RH-2	every 10 min.
Sheet 12	18.18	19.96	2	12:10 - 14:50	LHB+RHF	“
02/12/2014	32.36	34.08	4	10:00 - 12:50	All	every 10 min.
Sheet 12	17.67	19.64	2	14:10 - 15:30	LH-2	“
30/12/2014	30.11	30.20	4	12:20 - 15:50	All	every 10 min.
03/01/2015	32.56	33.87	4	12:30 - 17:00	All	“
05/01/2015	25.84	27.50	3	12:10 - 17:10	LHF+RF-2	“
sheet 15						

Average Readings in degCel.

	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>
Themometer	8.0	18.2	24.8	31.7
Temp. Sensors	10.5	20.0	26.8	32.7

Conclusions : Temperature Sensor results are about 1 to 2 degCel. more than the Themometer readings. And maximum output temperature for 4 KW is about 46 degCel. (sheet no. 12)

SETUP : 7

Rack without any modifications (aluminium cage in the rack removed). Kept 5 feet away from the cool air inlet duct. {Sheet number 17 in the temp_readings.ods file}

Date	Readings		Heat load of KW's	Time		Remarks
	T	S				
22/01/2015	-1.14	1.24	4	11:40 - 16:00	All	every 10 min.
Sheet 17						
23/01/2015	-1.26	2.27	3	10:00 - 14:20	LHB+RH-2	every 10 min.
Sheet 17	-3.22	1.27	2	14:30 - 15:50	LHB+RHB	“
	-5.25	-0.79	1	16:00 - 17:20	RHB	“

Average Readings in degCel.

	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>
Themometer	-5.2	-3.2	-1.3	-1.1
Temp. Sensors	-0.8	-1.3	-2.3	+1.2

Conclusions : Temperature Sensor results are about 1 to 4 degCel. less than the Themometer readings. And maximum output temperature for 4 KW is about 31.5 on 22/01/2015 sheet no. 17.

SETUP : 8

Rack without any modifications (aluminium cage in the rack removed). Kept over the cool air inlet duct. {Sheet number 17 in the temp_readings.ods file}

Date	Difference in Temperature Readings		Heat load of KW's	Time		Remarks
	T	S				
24/01/2015 Sheet 18	-2.78	-3.35	4	12:30 - 17:10	All	every 10 min.
30/01/2015 Sheet 18	-3.17	-2.20	3	10:30 - 14:50	LHB+RH-2	“
02/02/2015 Sheet 18	-3.21	-1.70	2	15:00 - 17:10	LHB+RHB	“
	-2.21	-0.50	1	10:00 - 12:00	LHF	“
	-3.04	-1.10	2	12:10 - 15:00	LH-2	“
	-3.14	-1.68	3	15:10 - 17:20	LH-2+RHB	“

Average Readings in degCel.

	<u>1KW</u>	<u>2KW</u>	<u>3KW</u>	<u>4KW</u>
Thermometer	-2.2	-3.1	-3.1	-2.8
Temp. Sensors	-0.5	-1.4	-2.0	-3.3

Conclusions : Temperature Sensor results are about 1.5 degCel. more than the Thermometer readings. And maximum output temperature for 4 KW is about 9.0 degCel 24/01/2015 sheet no. 18.

Conclusions :

Setup No.	Temperature Difference Range, for the Heat Load of				Remarks
	<u>1 KW</u>	<u>2 KW</u>	<u>3 KW</u>	<u>4 KW</u>	
1	2 – 4	5.5 – 8	10.5 – 12	not done	Thermometer Temp. Sensors
	4 – 4.5	8 – 8.5	11.5 – 13	not done	
Average	3.2	7	11.7	not done	
2	2 – 4	5 – 8.5	7.2 – 10	11 – 13	Thermometer Temp. Sensors
	4 – 5.2	7 – 9.5	10.3 – 12.5	13.5 – 15.5	
Average	3.6	7.2	9.8	13.2	
3	2 – 4	6 – 9.5	12.3 – 12.7	13.7 – 16.0	Thermometer Temp. Sensors
	4 – 6	8.7 – 12	14.6 – 15.3	16.4 – 18.7	
Average	4	8	13.8	16.2	
4	2.5 – 4.5	8.5 – 11.5	13.5 – 14.8	18.0 – 19.2	Thermometer Temp. Sensors
	6.2 – 6.6	12.0 – 13.3	16.5 – 17.7	21.2 – 21.7	
Average	4.6	10.9	15.6	19.8	

5	3.2 - 6.4 2.2 - 5.3	9.2 - 9.6 6.1 - 6.8	10.1 - 11.9 8.2 - 10.5	17.8 - 19.1 11.4 - 13.1	Thermometer Temp. Sensors
Average	4.3	7.8	10.0	10.4	
6	8.0 10.5	17.7 - 18.7 19.6 - 20.6	23.8 - 25.9 26.1 - 27.5	30.1 - 32.5 30.2 - 34.0	Thermometer Temp. Sensors
Average	9.2	19.2	25.8	32.0	
7	-5.25 -0.79	-3.22 1.27	-1.26 2.27	-1.14 1.24	Thermometer Temp. Sensors
Average	- 3.02	- 1.0	- 0.5	0.05	
8	-2.21 -0.50	-3.04 - -3.21 -1.10 - -1.70	-3.08 - -3.14 -1.68 - -2.20	-3.35 -2.78	Thermometer Temp. Sensors
Average	-1.35	-2.15	-2.41	-3.1	

<u>Setup#</u>	<u>with al. plate</u> <u>Ther / T.Sensor</u>	<u>w/o al. plate (inside the al. cage which obstructs the air flow)</u> <u>Ther / T.Sensor</u>	<u>Remarks</u>
2a	6.23 / 8.89	3.50 / 6.06	--
3a	9.55 / 10.98	6.12 / 5.33	--
3b	10.64 / 13.26	10.82 / 12.84	slot in the al. cage at 2' height open. This temp. diff. increases by 1 degCel., if we put 3 fans of 100cfm at open slot.

V Daily Readings :

Please refer the file temp_readings.ods attached with this report.

VI Air Flow meter User Manual :



Visit the webpage :

<http://www.extech.com/instruments/product.asp?catid=1&prodid=600>

and click at the

English User's Manual

under Downloads & Software

for complete User Manual.

OR

Documents available with the Meter.

OR

file “HD350_UM.pdf” attached with this Report.

Introduction :

Congratulations on your purchase of the Extech HD350. This handheld meter measures and displays air velocity (speed), air flow (volume), ambient air temperature, and gauge/differential pressure. This meter is shipped fully tested and calibrated and, with proper use, will provide years of reliable service.